


5'X5' CONCRETE SLAB
6" THICK

HALF SECTION

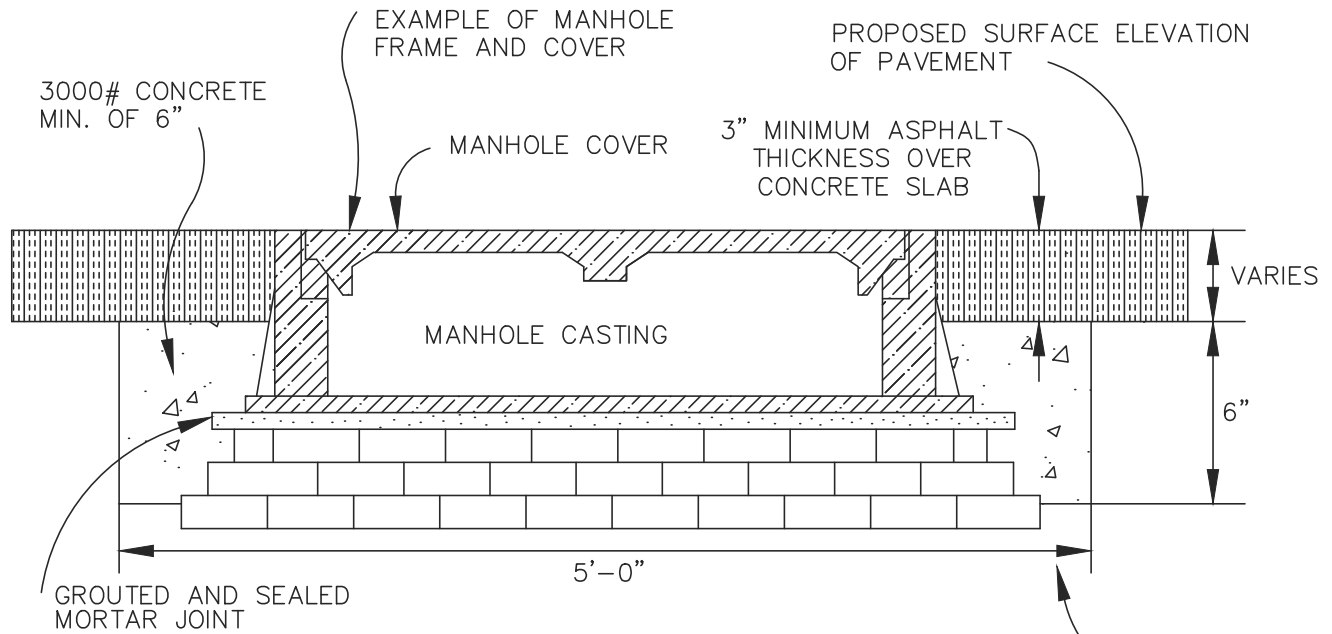

3000# CONCRETE
MIN. OF 6"

EXAMPLE OF MANHOLE
FRAME AND COVER

MANHOLE COVER

3" MINIMUM ASPHALT
THICKNESS OVER
CONCRETE SLAB

PROPOSED SURFACE ELEVATION
OF PAVEMENT

GROUTED AND SEALED
MORTAR JOINT

WATER AND HARD TAMP
SUBGRADE TO 100% OF
AASHTO T180 OR ASTM D698-70

MANHOLE ADJUSTMENT DETAILS



STANDARD CONSTRUCTION DETAIL
MANHOLE ADJUSTMENT DETAILS
NTS

INDEX

S-9C

MAY 2020