




F.D.O.T. TYPE "F" CURB

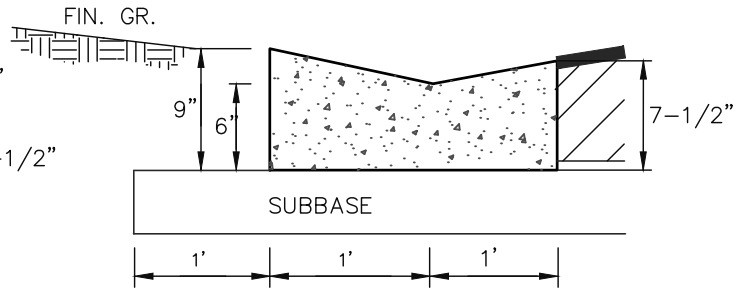


MIAMI CURB

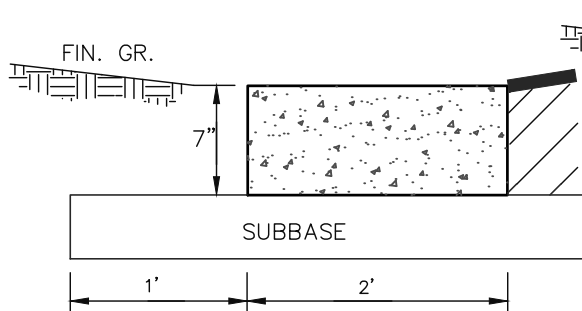


ENVIRONMENTAL CURB

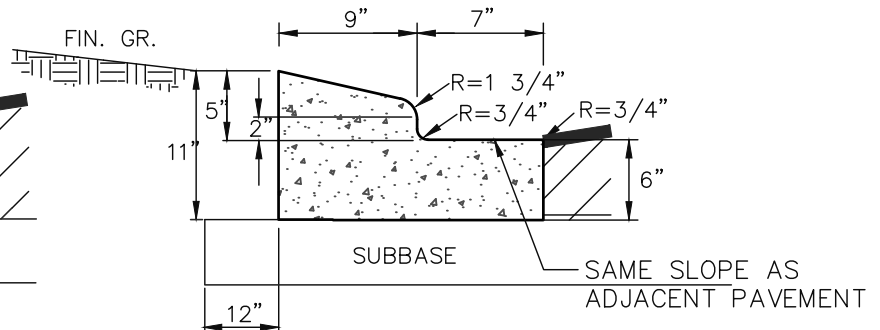

F.D.O.T. TYPE "A" CURB

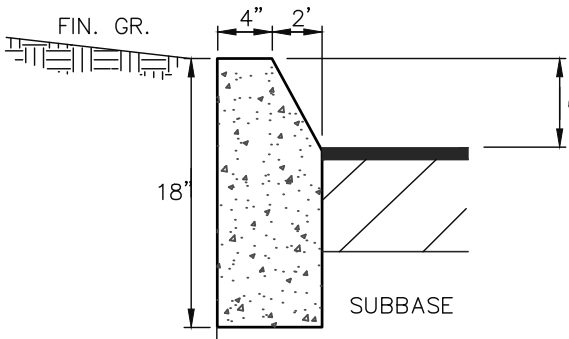

HEADER CURB

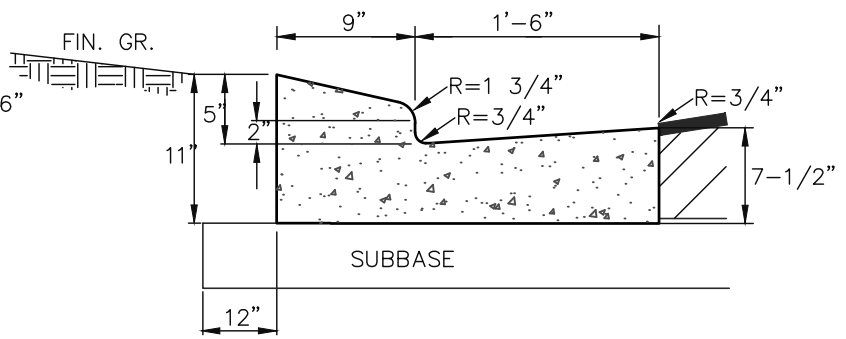

F.D.O.T. TYPE "E" CURB

NOTES:

1. ALL CURBS TO BE CONSTRUCTED OF 28 DAY, 2500 P.S.I. CONCRETE
2. 1/2" PRE-MOLDED EXPANSION JOINT REQUIRED EVERY 500', CONSTRUCTION JOINT REQUIRED EVERY 10' MAXIMUM (4' MINIMUM).
3. 1/2" PRE-MOLDED EXPANSION JOINT REQUIRED AT EACH SIDE OF ALL STORM INLET STRUCTURES AND AT ALL RADIUS POINTS.
4. 6" SUBBASE TO BE COMPACTED AND TESTED TO 98% DENSITY WITH MINIMUM L.B.R. 40 BASED ON AASHTO T-180 MODIFIED PROCTOR TEST.
5. EXPANSION JOINT MATERIAL MUST COVER THE ENTIRE CROSS SECTION OF CURB.
6. ALL EXPOSED CORNERS TO BE ROUNDED AT 3/4" MIN. RADIUS.
7. ALL CURB ENDS THAT DO NOT TIE INTO OTHER FACILITIES SHALL TRANSITION DOWN TO PAVEMENT GRADE IN 24 INCHES.



STANDARD CONSTRUCTION DETAIL

STANDARD CURB CONSTRUCTION

NTS

INDEX

R-4

MAY 2020